FTXM71M

The → mark shows the piping direction.

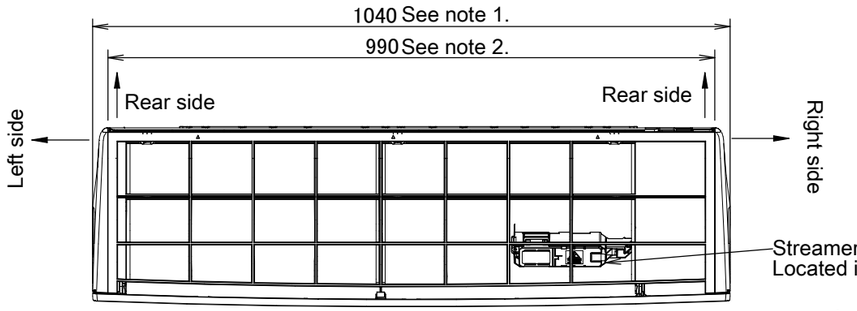

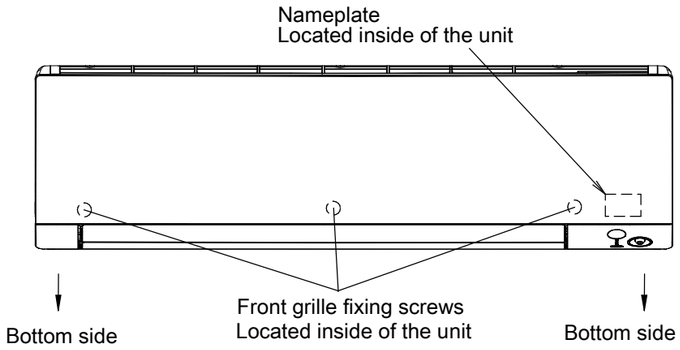

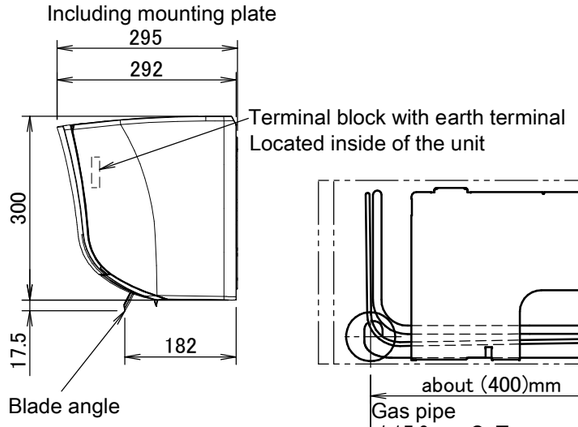

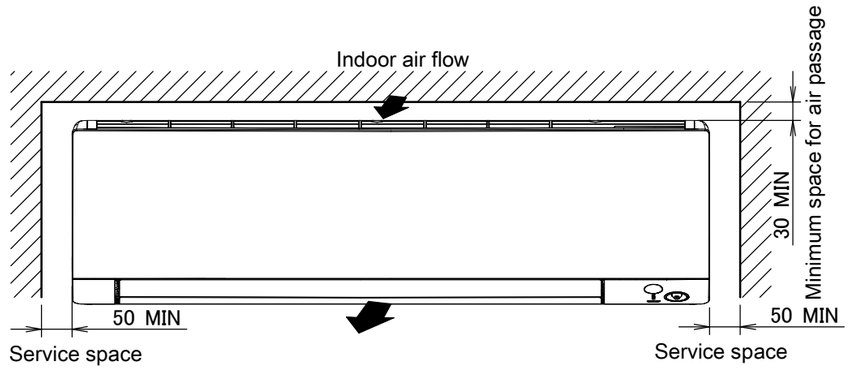

Required space for service and ventilation

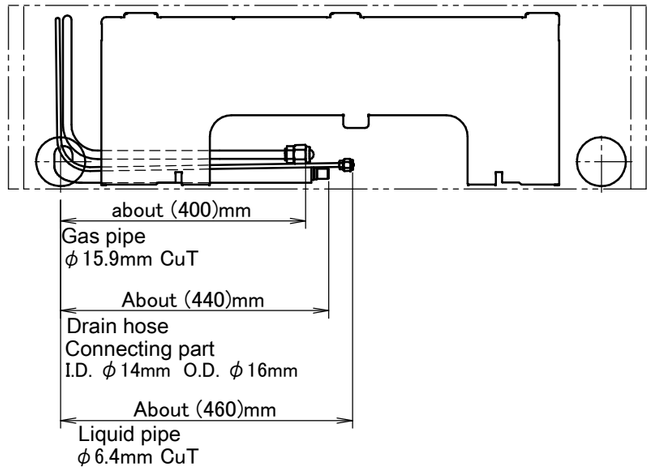

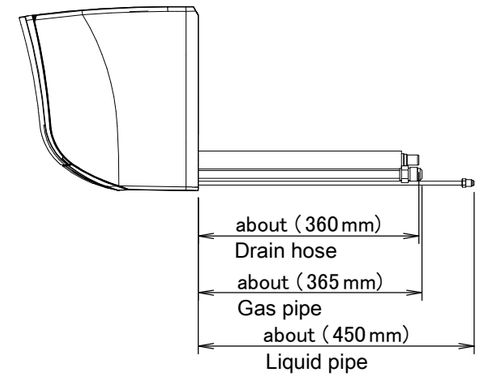

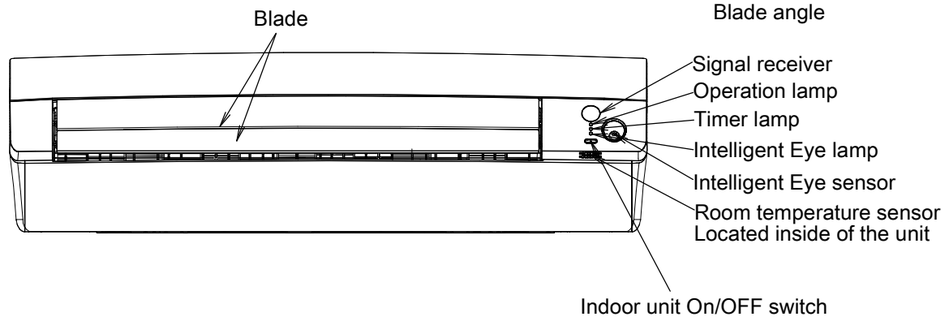

Wireless remote control

(ARC466A33)

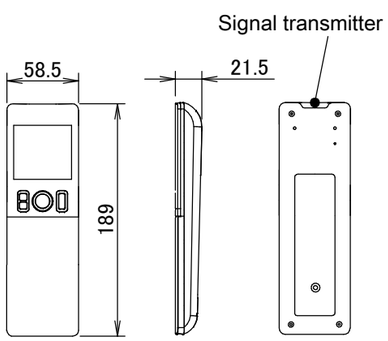

Blade angle

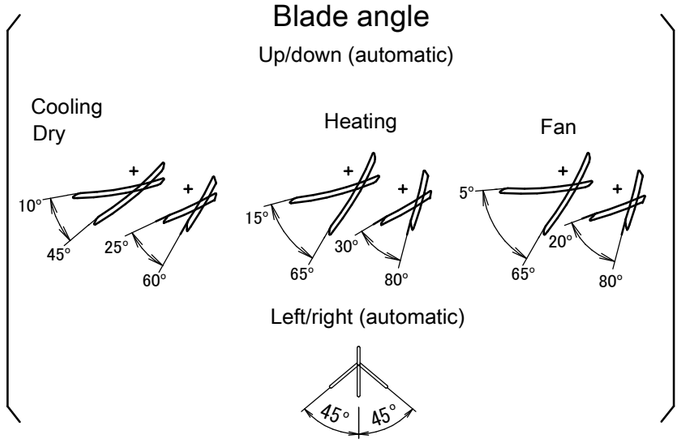

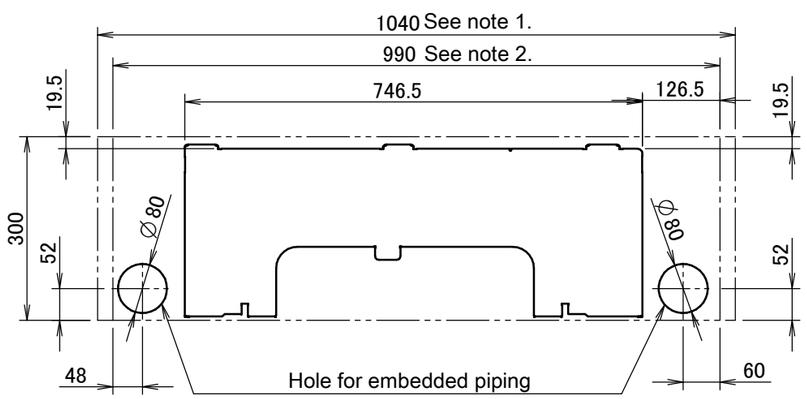

Standard location of holes in the wall

Notes

1. Total width of unit
2. Width of unit against the wall
3. Editable data for this drawing are available in the GDE (E-BOM) system.

3D101374B